



Replacement Sheet

+

Figure 1A

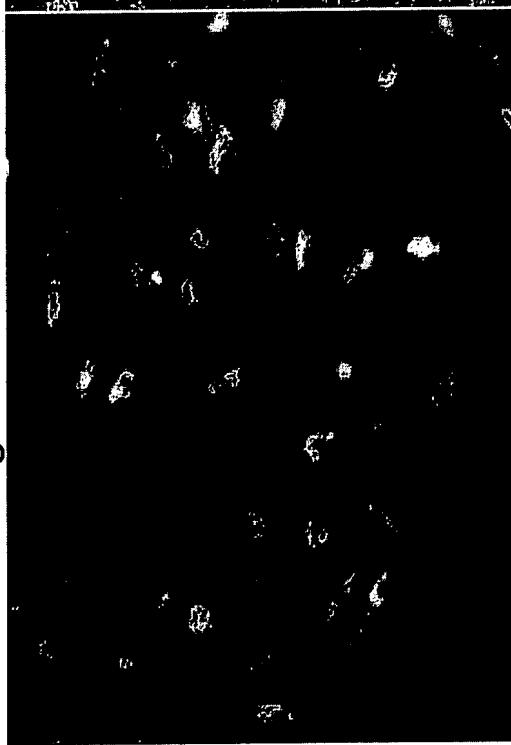


Figure 1B



(1/20)

Figure 1C



+

Replacement Sheet

**Figure 2**



+

(6/20)

Figure 6A



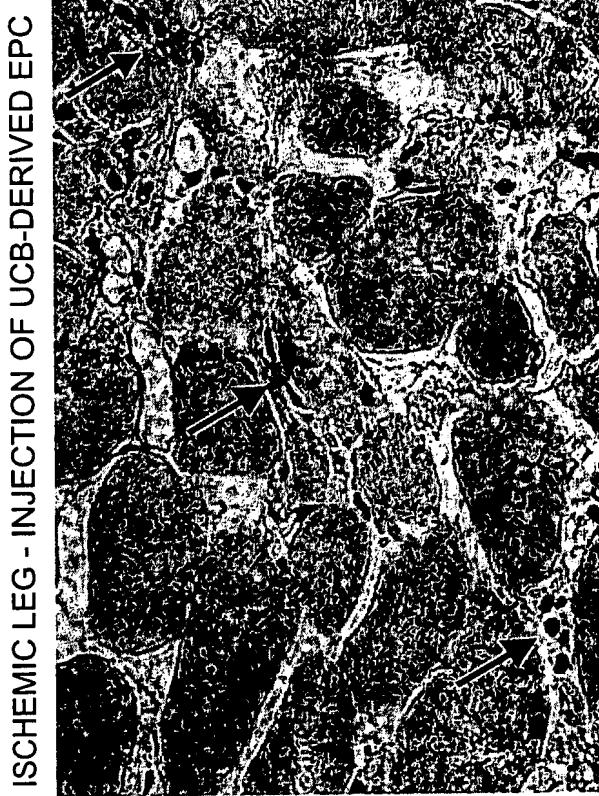


Figure 6B

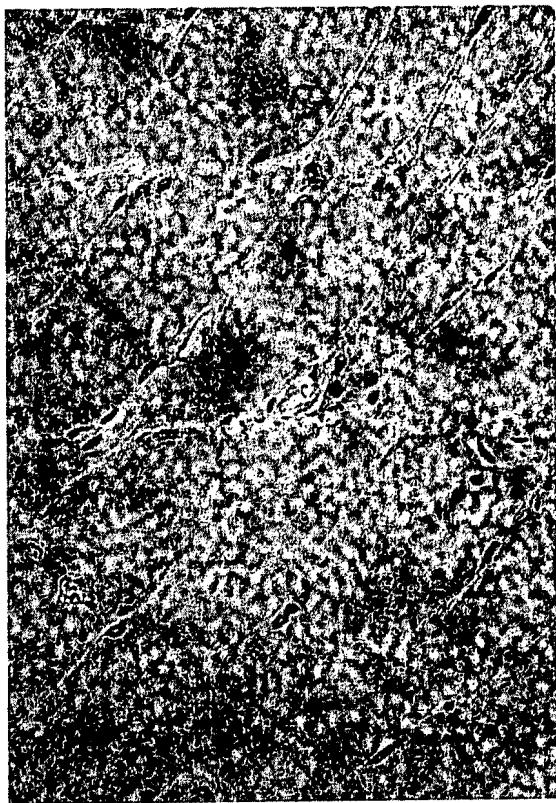

Replacement Sheet

Figure 13

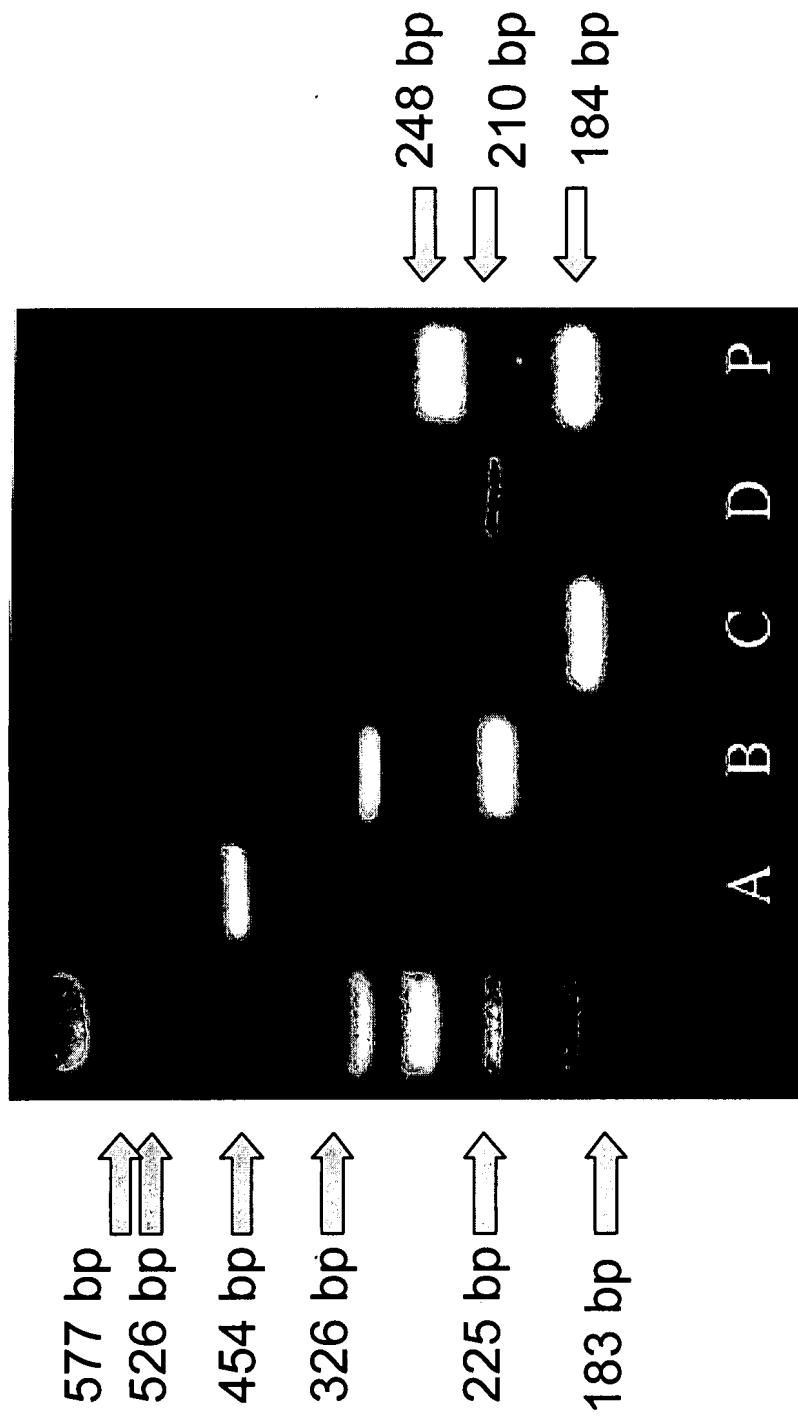

Replacement Sheet

**Figure 14**

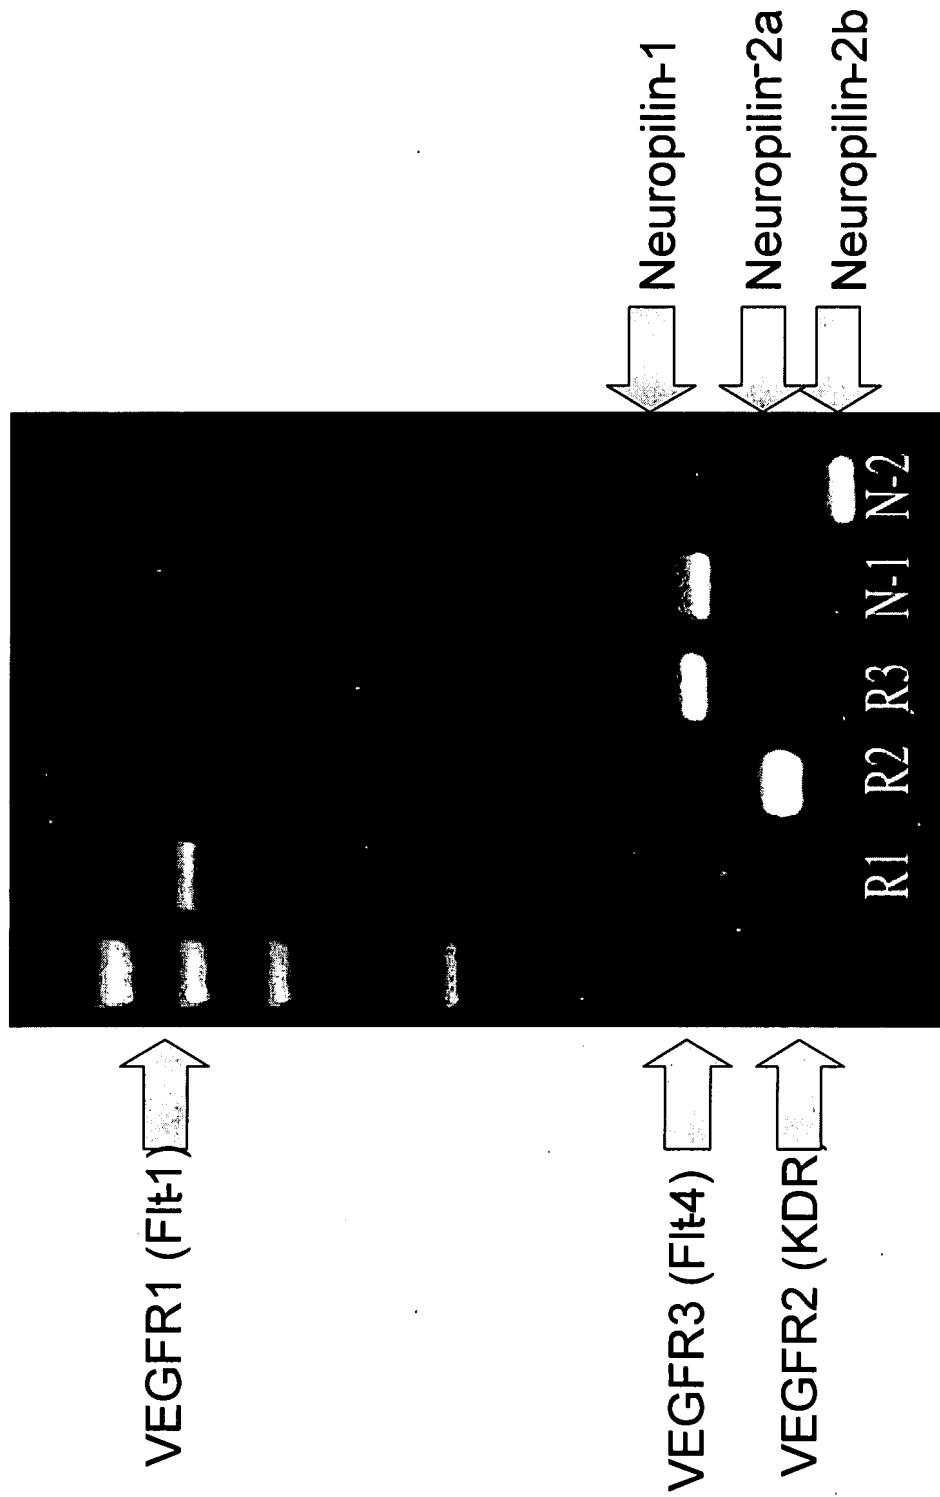


Figure 16A  
HUVECs ON 1% GELATIN COATED PLATE.

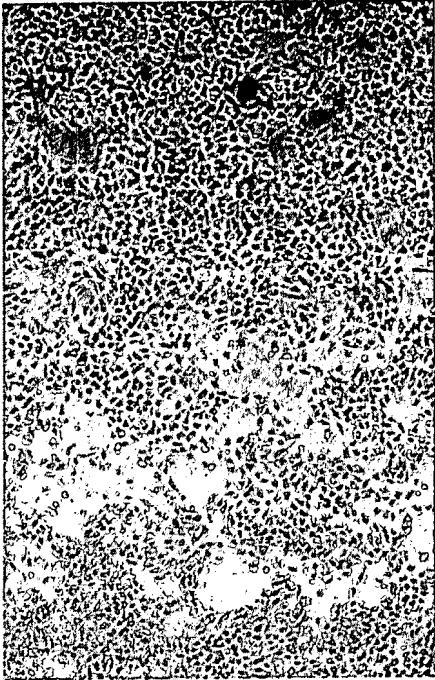


Figure 16B  
HUVECs IN VITROGEN3D COLLAGEN GEL

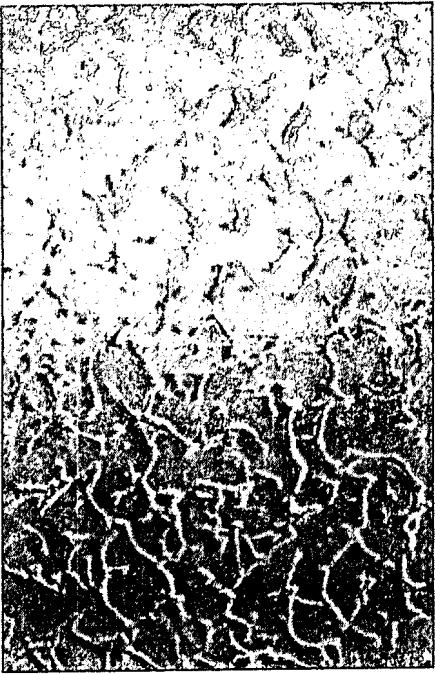


Figure 16C  
DIL STAINED hMSCs 1 HOUR AFTER  
ADDITION TO HUVECs IN 3D COLLAGEN GEL

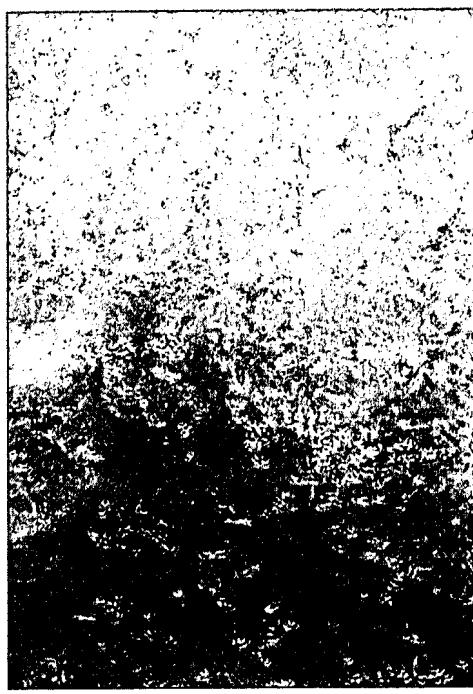


Figure 16D  
DIL STAINED hMSCs 72 HOURS AFTER  
ADDITION TO HUVECs IN 3D COLLAGEN GEL




(16/20)

+

Replacement Sheet

Figure 18

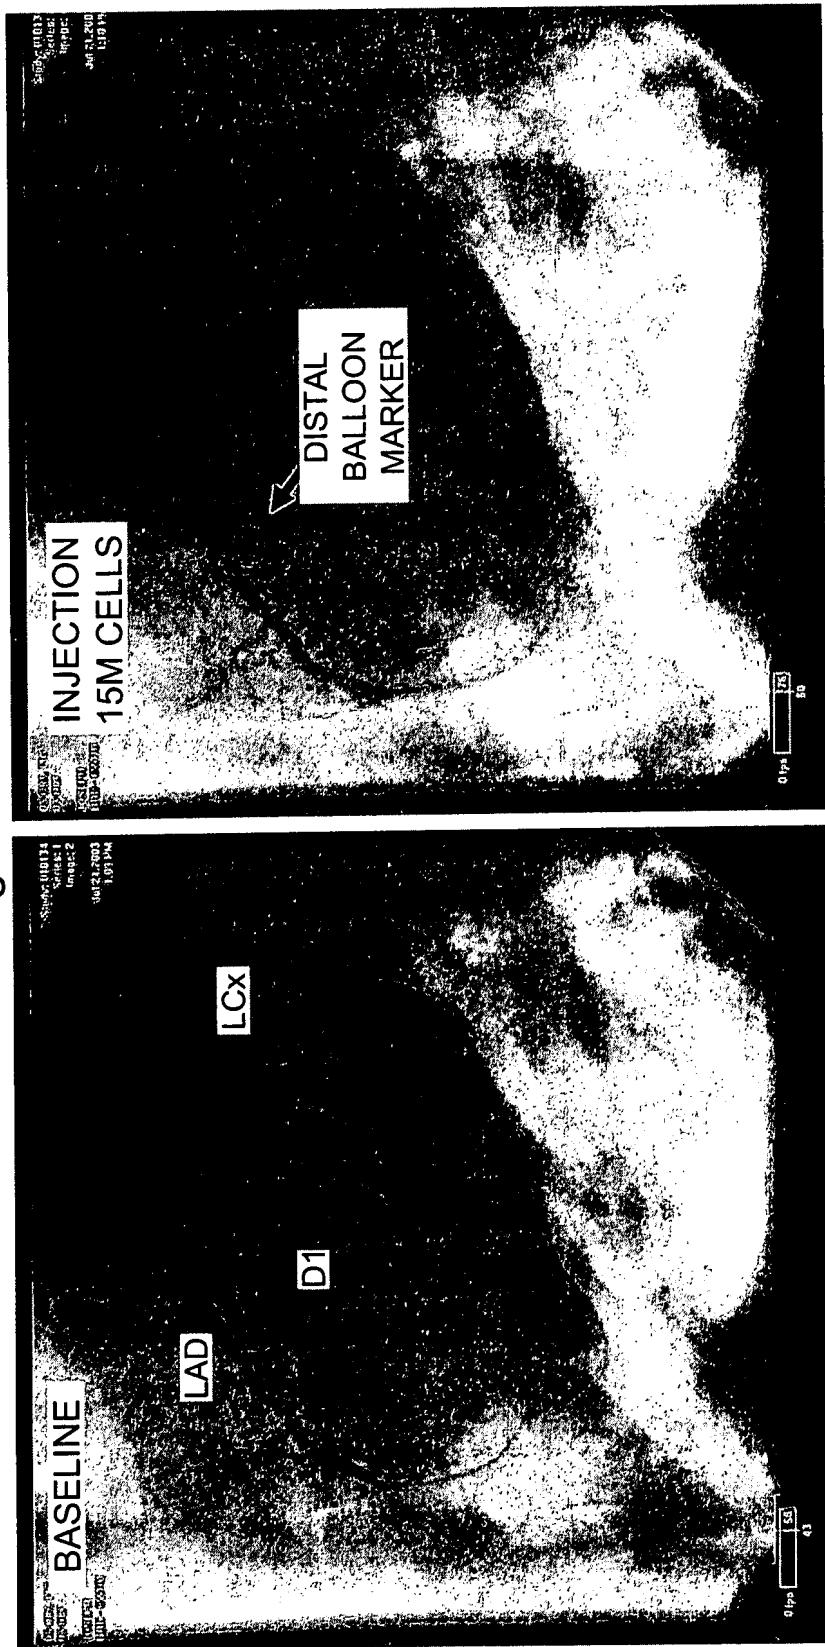

(18/20)